

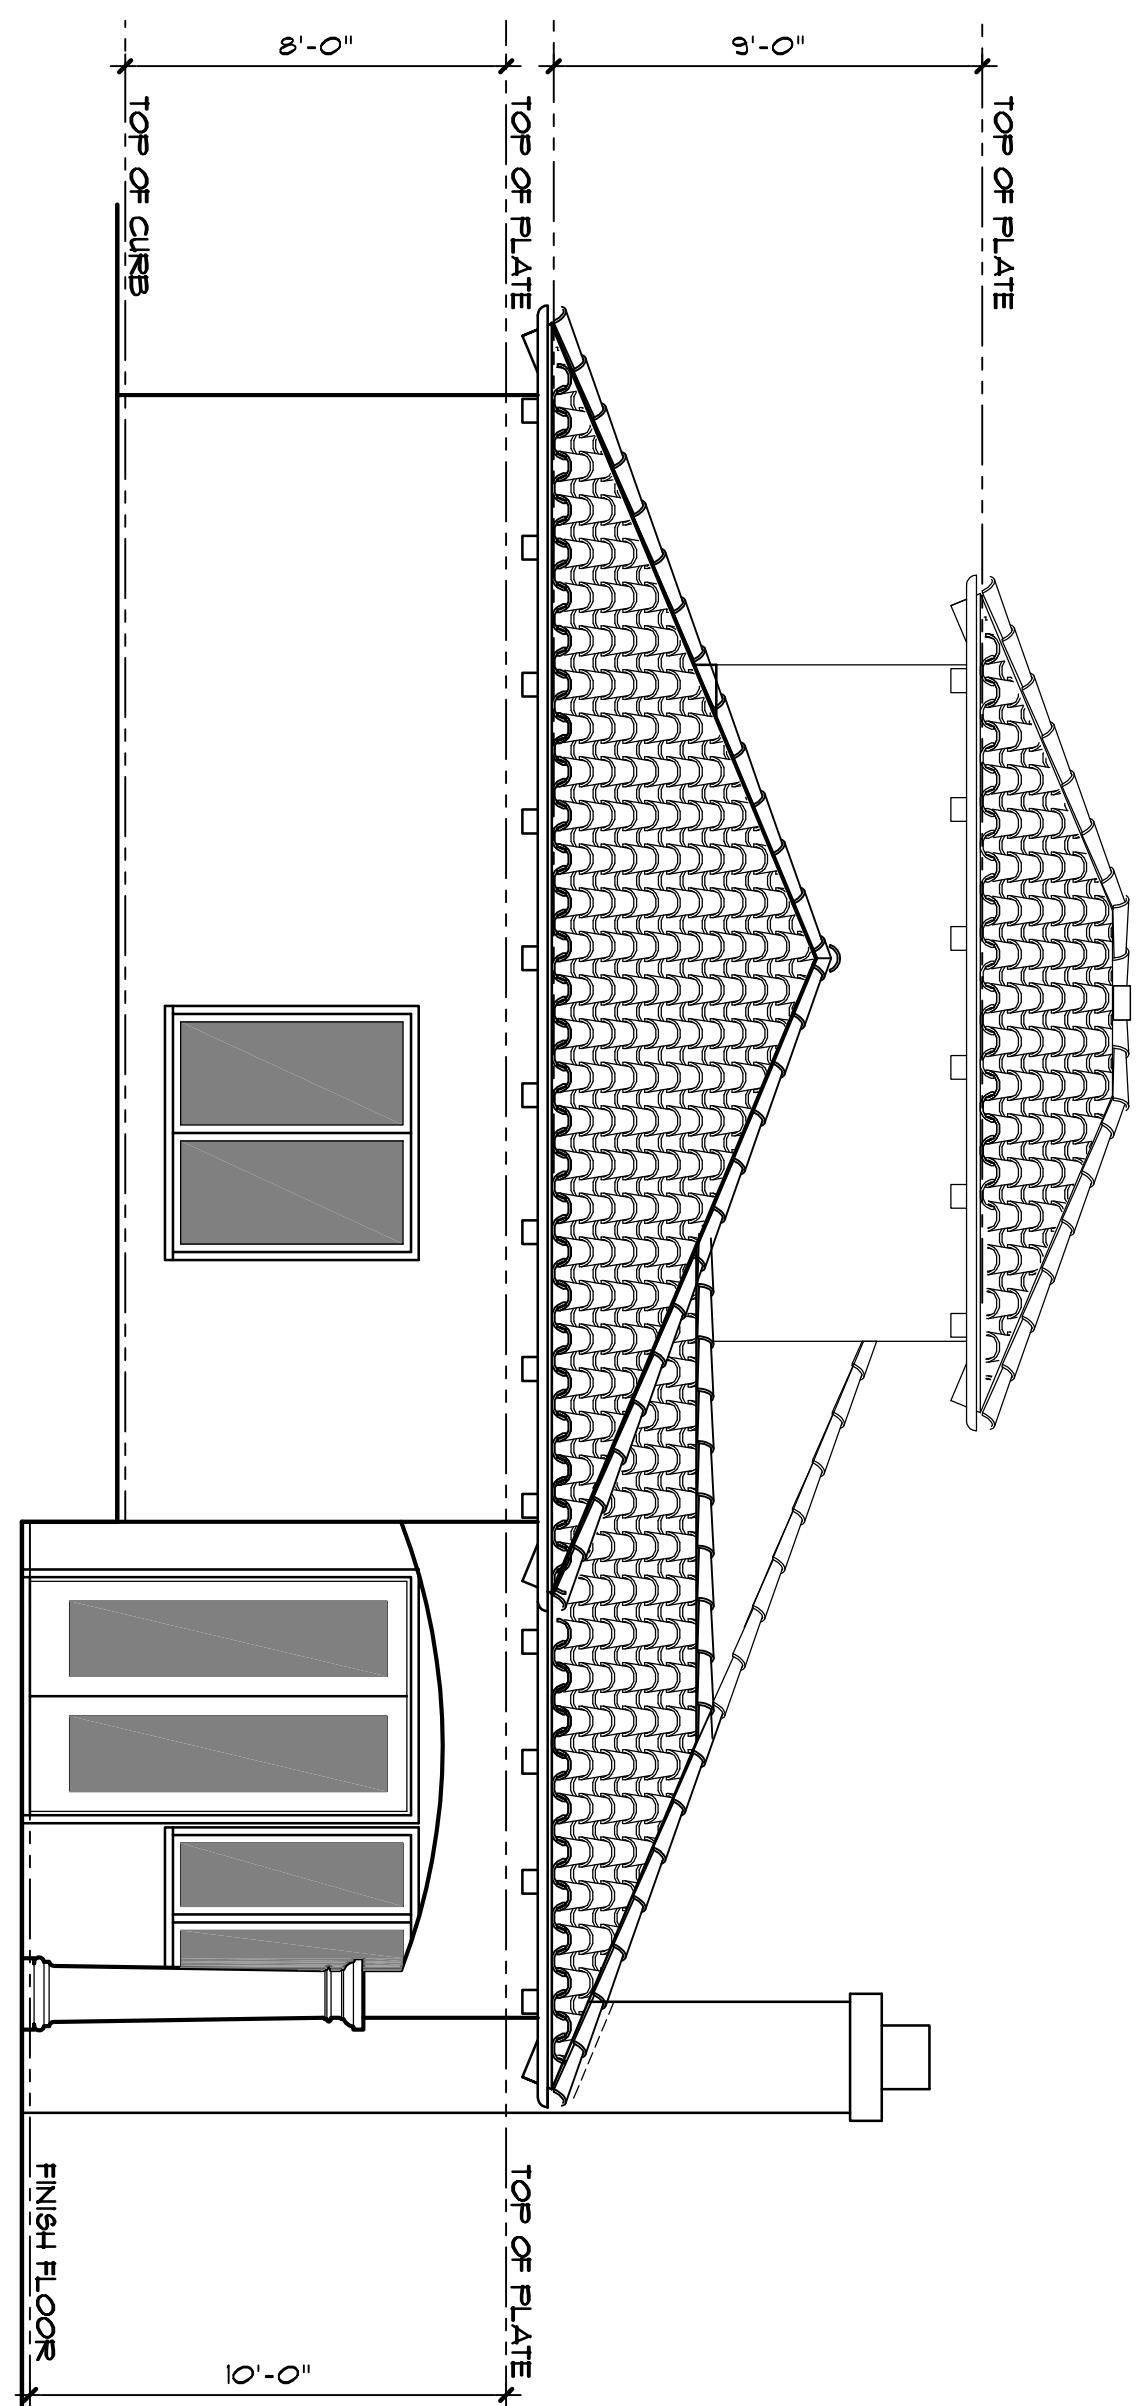
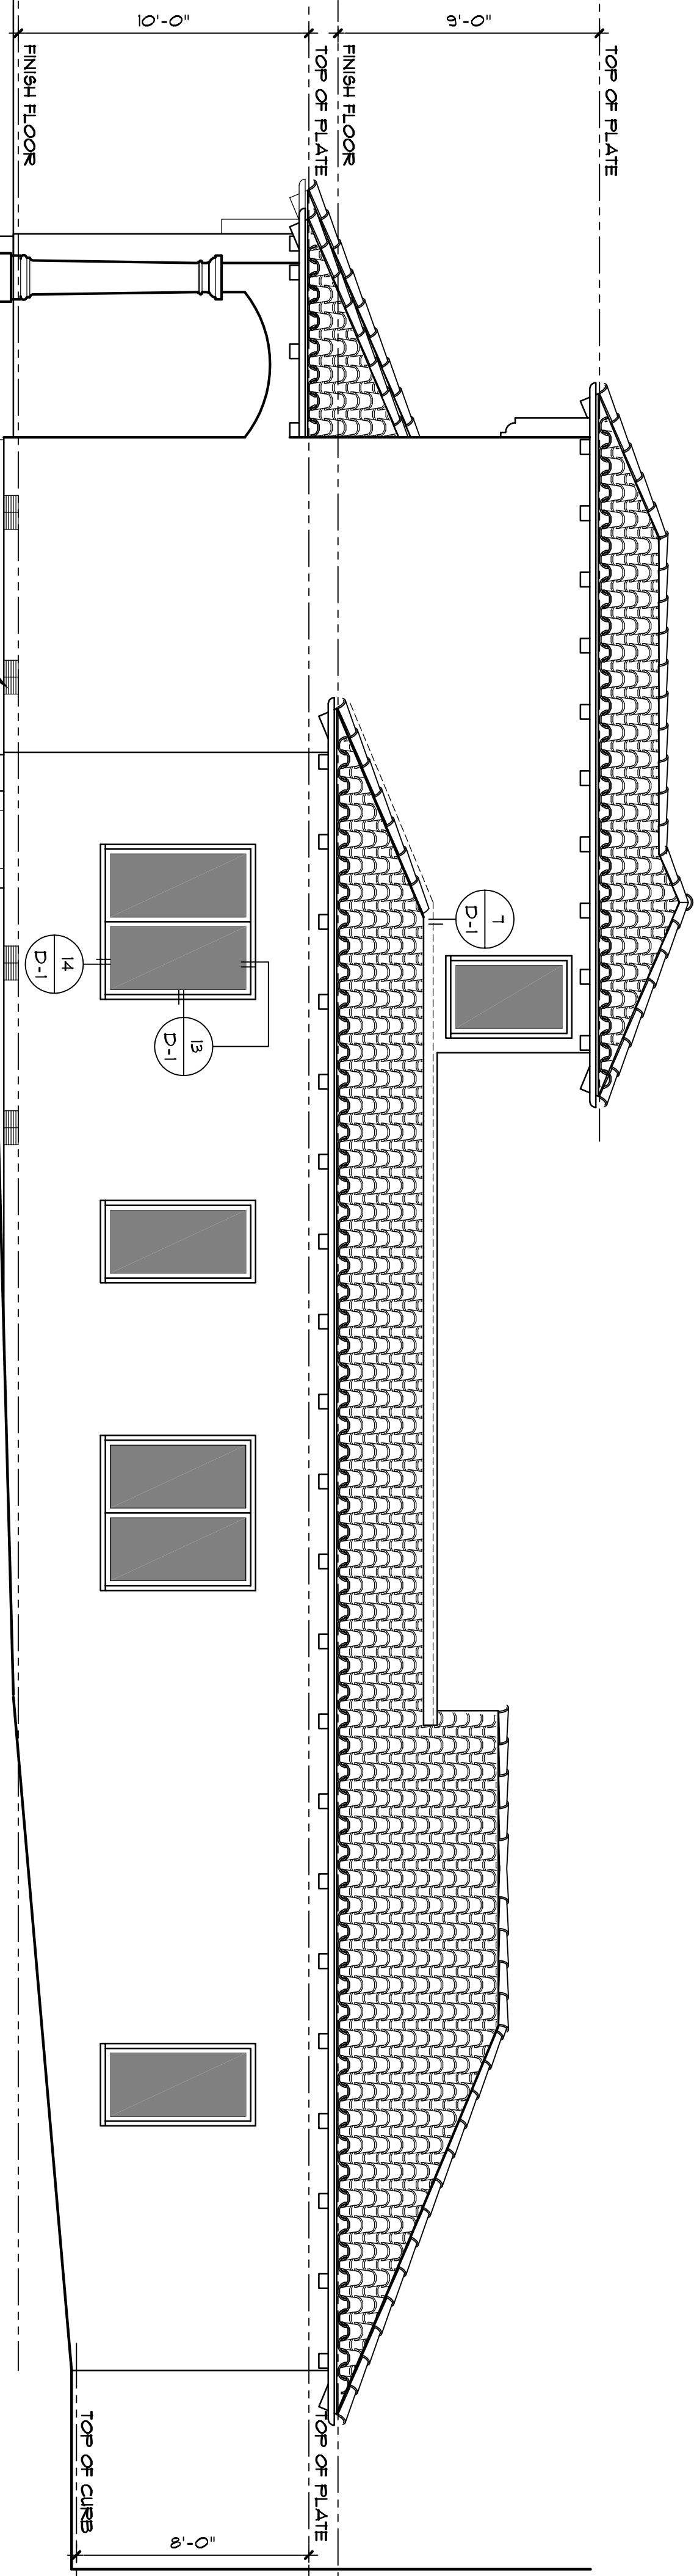
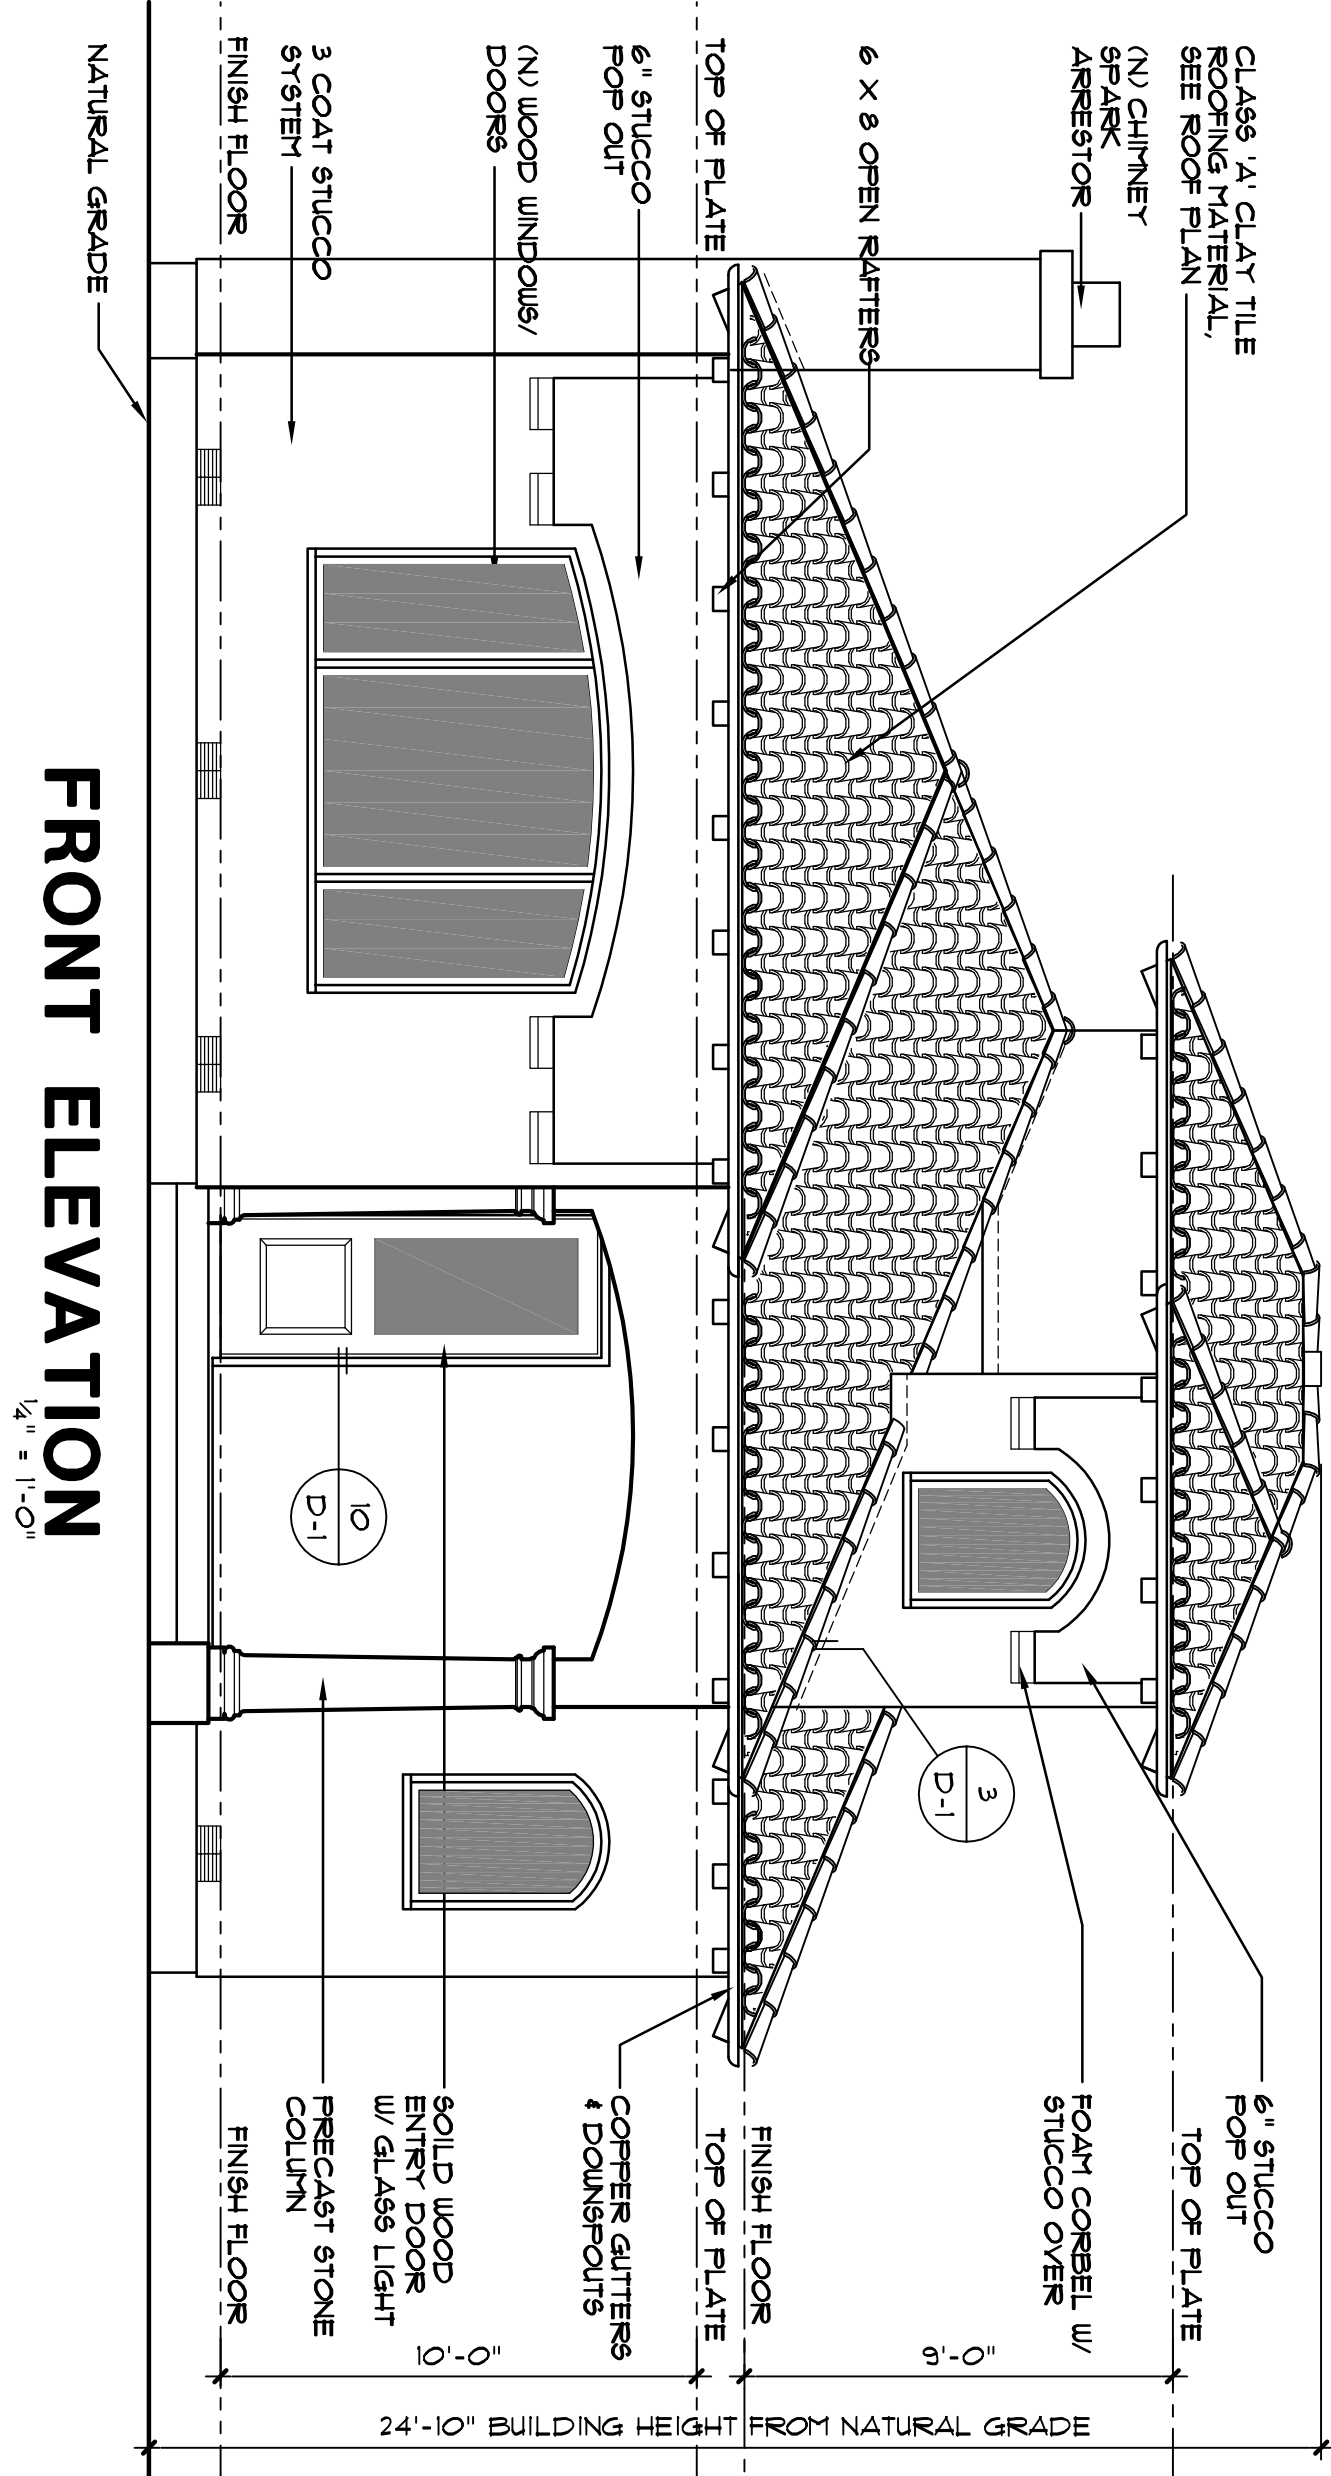


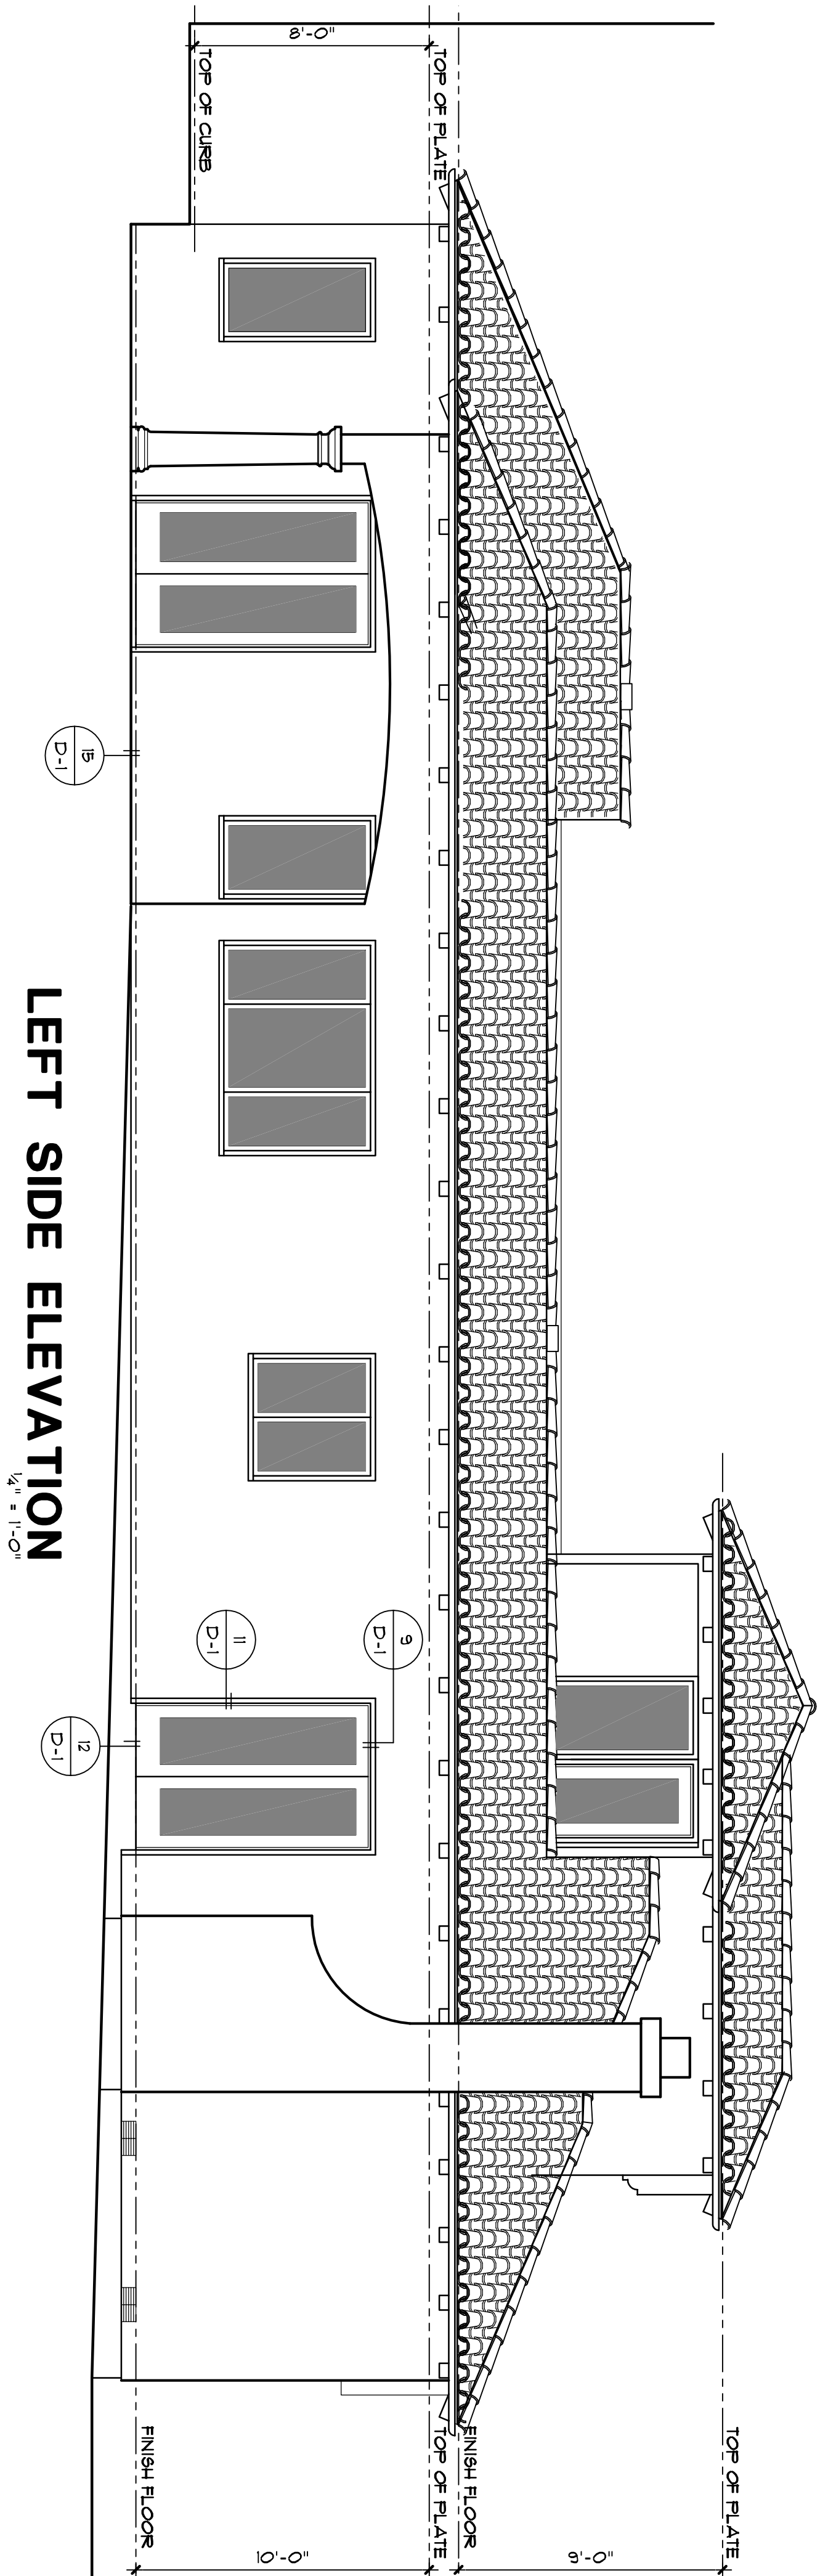



14' X 6' UNDER FLOOR VENTS TOTAL GF IS REQUIRED
w/ 1/4" CORROSION RESISTANT METAL FRESH COVERING
FLOOR VENT CALC:
14' X 6' UNDER FLOOR VENT = 84.0 SQ. FT.
24' X 8' UNDER FLOOR ACCESS = 192.0 SQ. FT.
TOTAL AREA = 276.0 SQ. FT.

24' X 8' UNDER FLOOR ACCESS
w/ 1/4" CORROSION RESISTANT METAL FRESH COVERING
FLOOR VENT CALC:
24' X 8' UNDER FLOOR ACCESS = 192.0 SQ. FT.
TOTAL AREA = 276.0 SQ. FT.

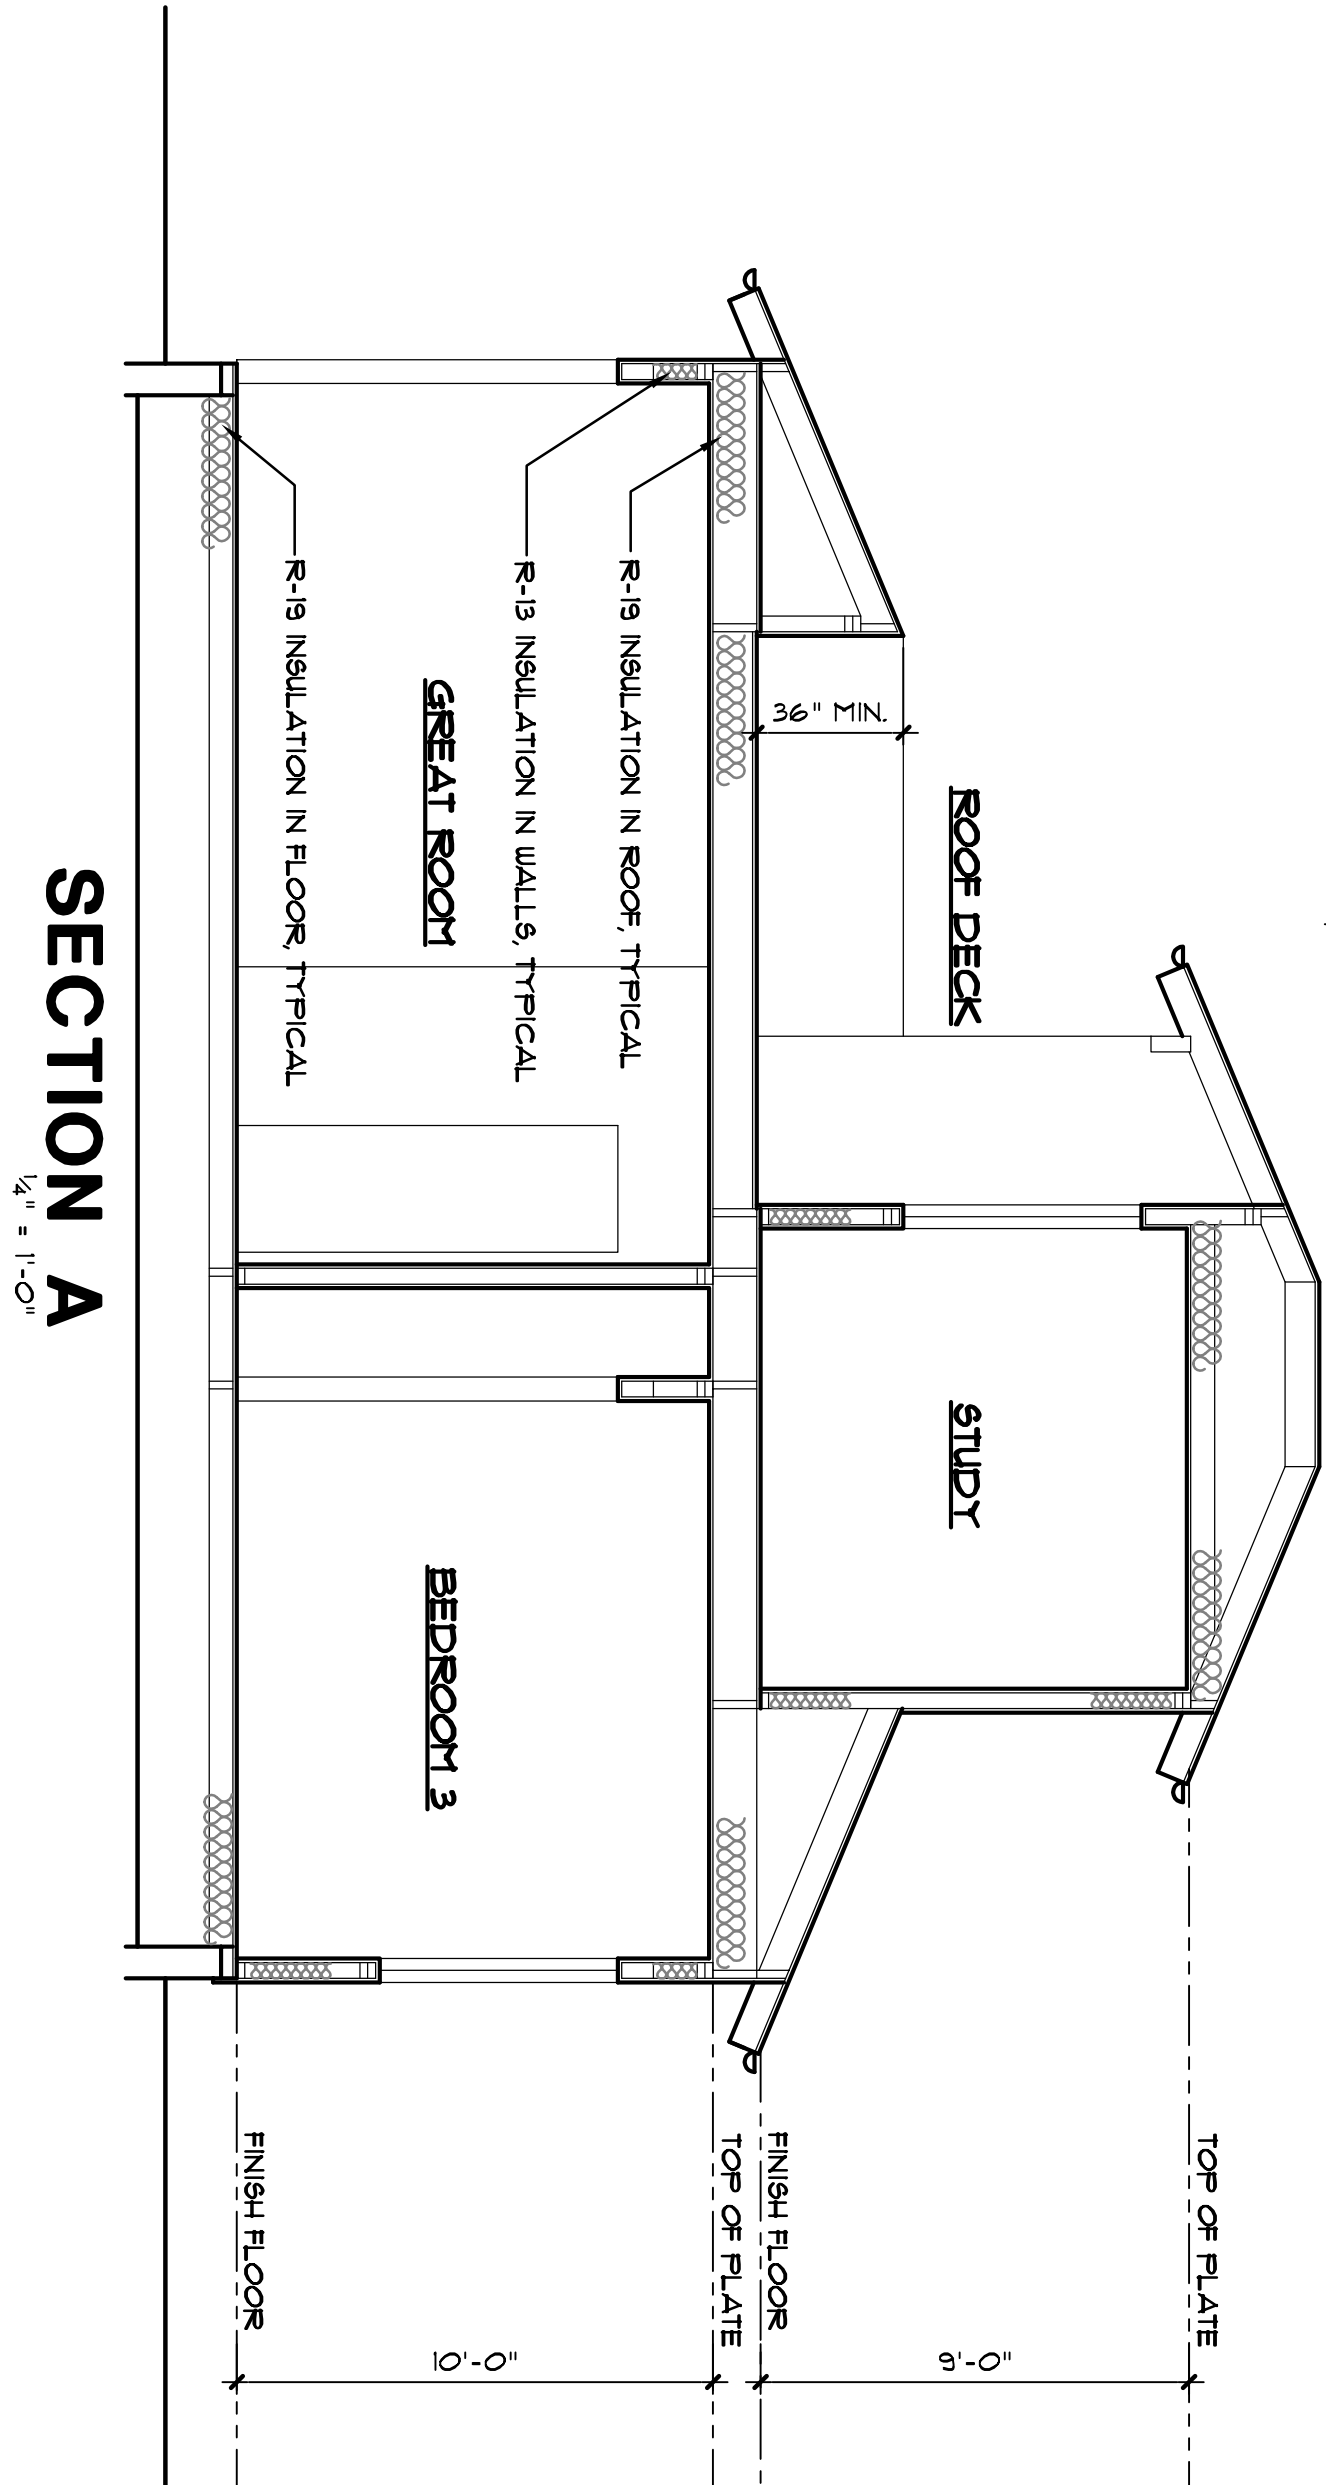

ROOF NOTES
1. ALL ROOF TO WALL FLASHING SHALL BE 26 GA. GALV. FLASHING.
2. PROTECTION OF OPENINGS, OPENINGS INTO ATTICS, FLOORS, OR OTHER ENCLOSED AREAS SHALL BE NOT GREATER THAN 1/4" IN ANY DIMENSION.
3. ROOFING MATERIAL:
MANUF.: REDLANDS CLAY TILE
STYLE: APPROVED EQUAL
WEIGHT: 11 PPS
TESTING NO.: ER-4300
ATTIC VENTILATION
(NEW & EXISTING VERIFY OR INSTEAD)
FIRST FLOOR ATTIC: 180 SF. / 50x32 (144x132) 48 INCHES REQUIRED. "JALANIN" (42 S.I. ELY)
PROVIDE 32 RAFTER VENTS
SECOND FLOOR ATTIC: 187 SF. / 50x12.46 (144x11.35) 50 INCHES REQUIRED
ROOF VENTILATION BY "JALANIN" (42 S.I. ELY)
PROVIDE 4 RAFTER VENTS

REAR ELEVATION
1/4" = 1'-0"

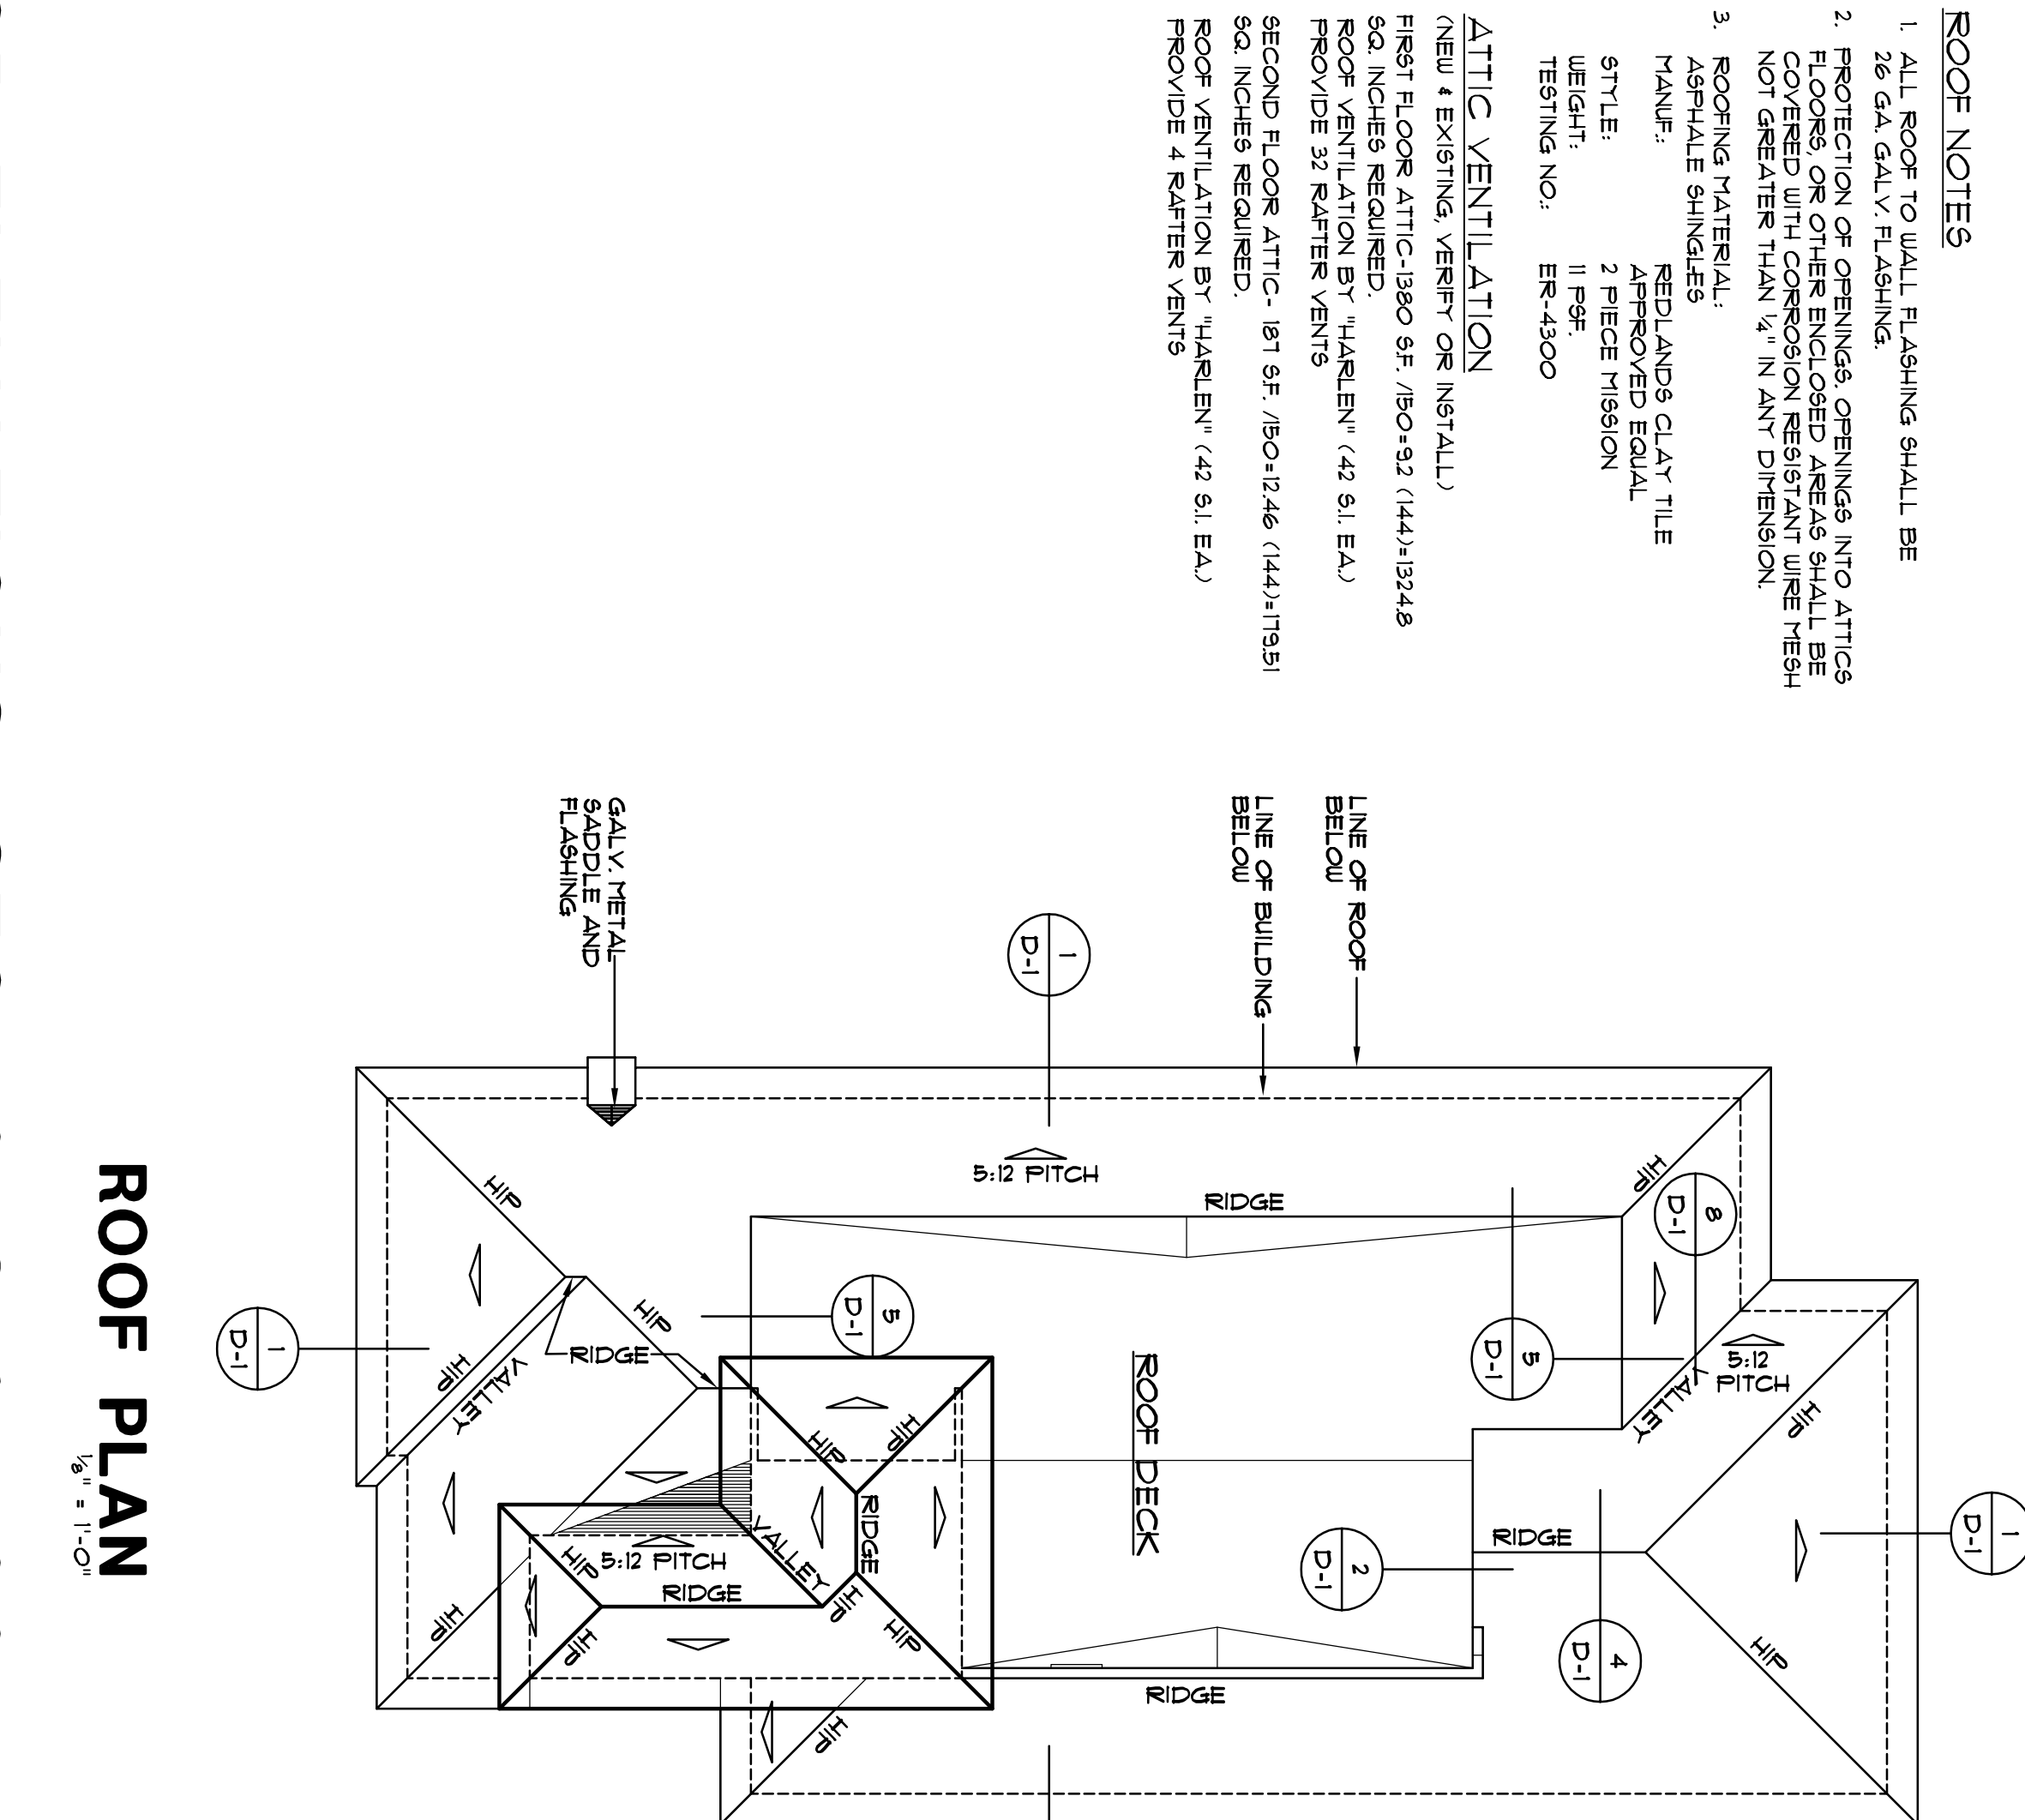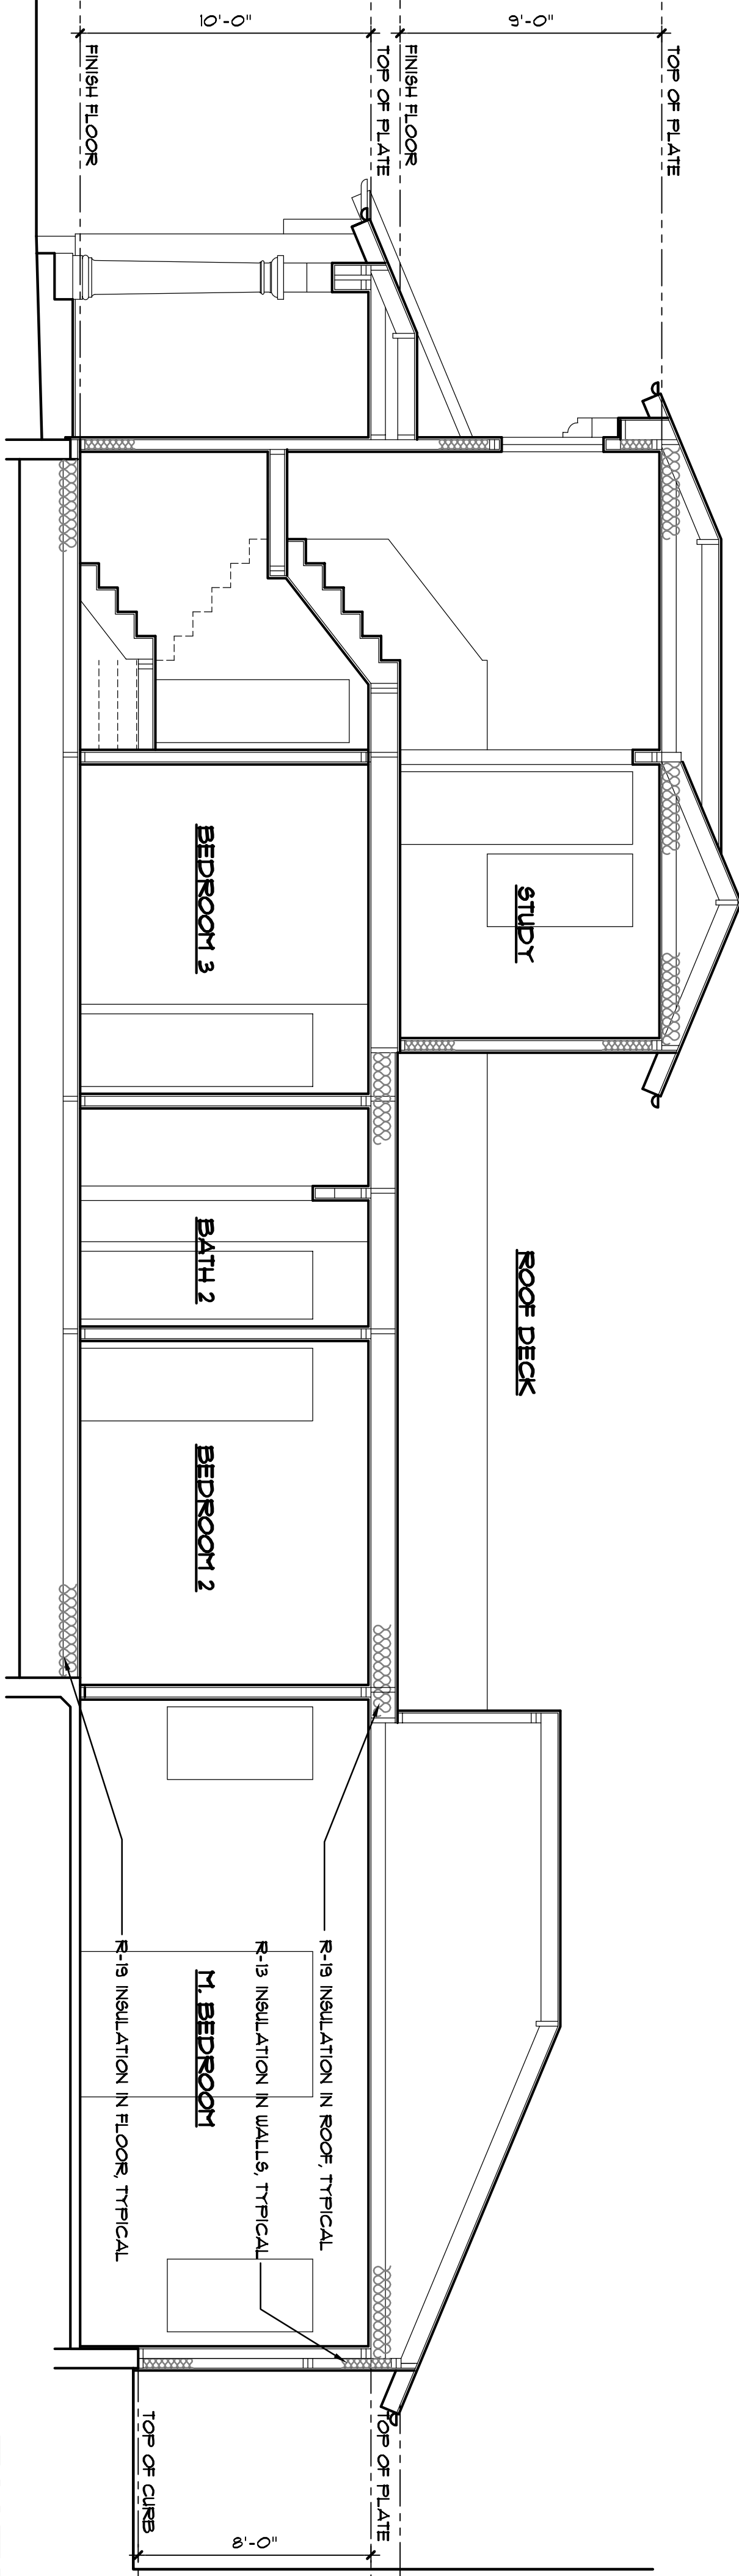

SECTION B
1/4" = 1'-0"

EXTERIOR ELEVATIONS, SECTIONS & ROOF PLAN
1/4" = 1'-0"